
## CONTRACTION JOINT DETAIL

## EXPANSION JOINT DETAIL

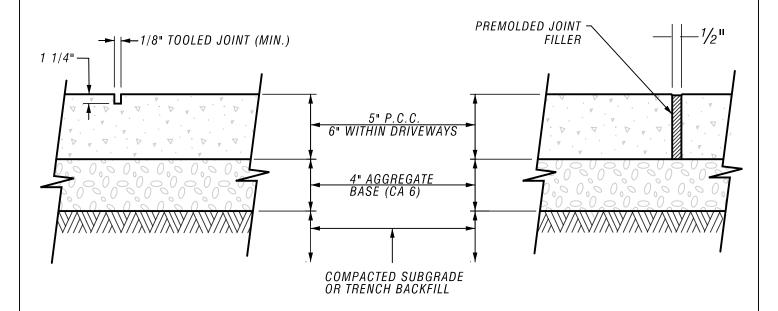

## NOT TO SCALE

## **NOTES**

- 1. UNLESS OTHERWISE NOTED ON PLANS, CONTRACTION JOINTS TO BE AT 5'-0" O.C.
- 2. EXPANSION JOINTS TO BE 50'-0" O.C. MAX. OR AT BACK OF CURB, CHANGE OF DIRECTION, OTHER WALK, UTILITY APPURTENANCE, OR FACE OF STRUCTURE.
- 3. PORTLAND CEMENT CONCRETE SHALL CONFORM TO IDOT CLASS SI OR PV,
- 4. PROVIDE A BROOM FINISH FOR CONCRETE SURFACES.
- 5. REPLACEMENT IS REQUIRED TO THE NEAREST JOINT UNLESS SPECIFIED BY THE TOWNSHIP ENGINEER.

REVISED 12-16-24



CONCRETE SIDEWALK DETAIL

