


NOT TO SCALE

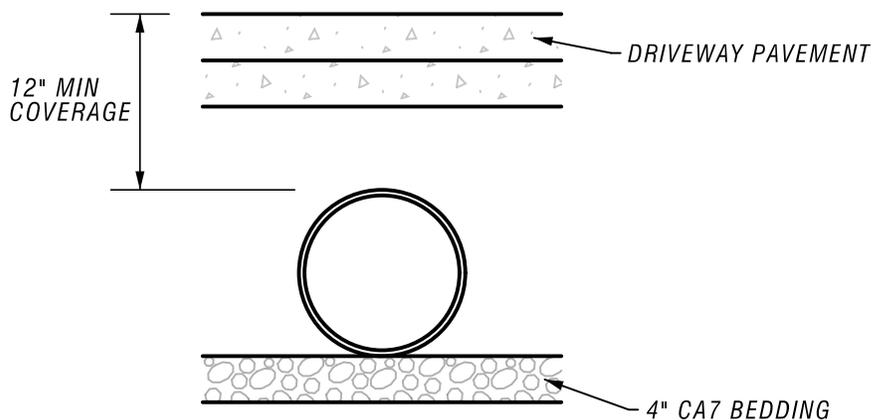

NOT TO SCALE

**NOTES**

1. CULVERT MUST BE A MINIMUM OF 12 INCH PVC PIPE OR LARGER AND EXTEND A MINIMUM OF 3 FEET ON EITHER SIDE OF DRIVEWAY.
2. DEPTH OF CULVERT PIPE TO BE A MINIMUM OF 12 INCHES FROM TOP OF PIPE TO TOP OF DRIVEWAY PAVEMENT.

REVISED 12-16-24

9575 W. Higgins Road  
Suite 700  
Rosemont, Illinois 60018  
Phone: (847) 696-4060  
spacecoinc.com

**DRIVEWAY CULVERT  
DETAIL**

